


Aquamira Water Bottle Filter Chlorine Removal %

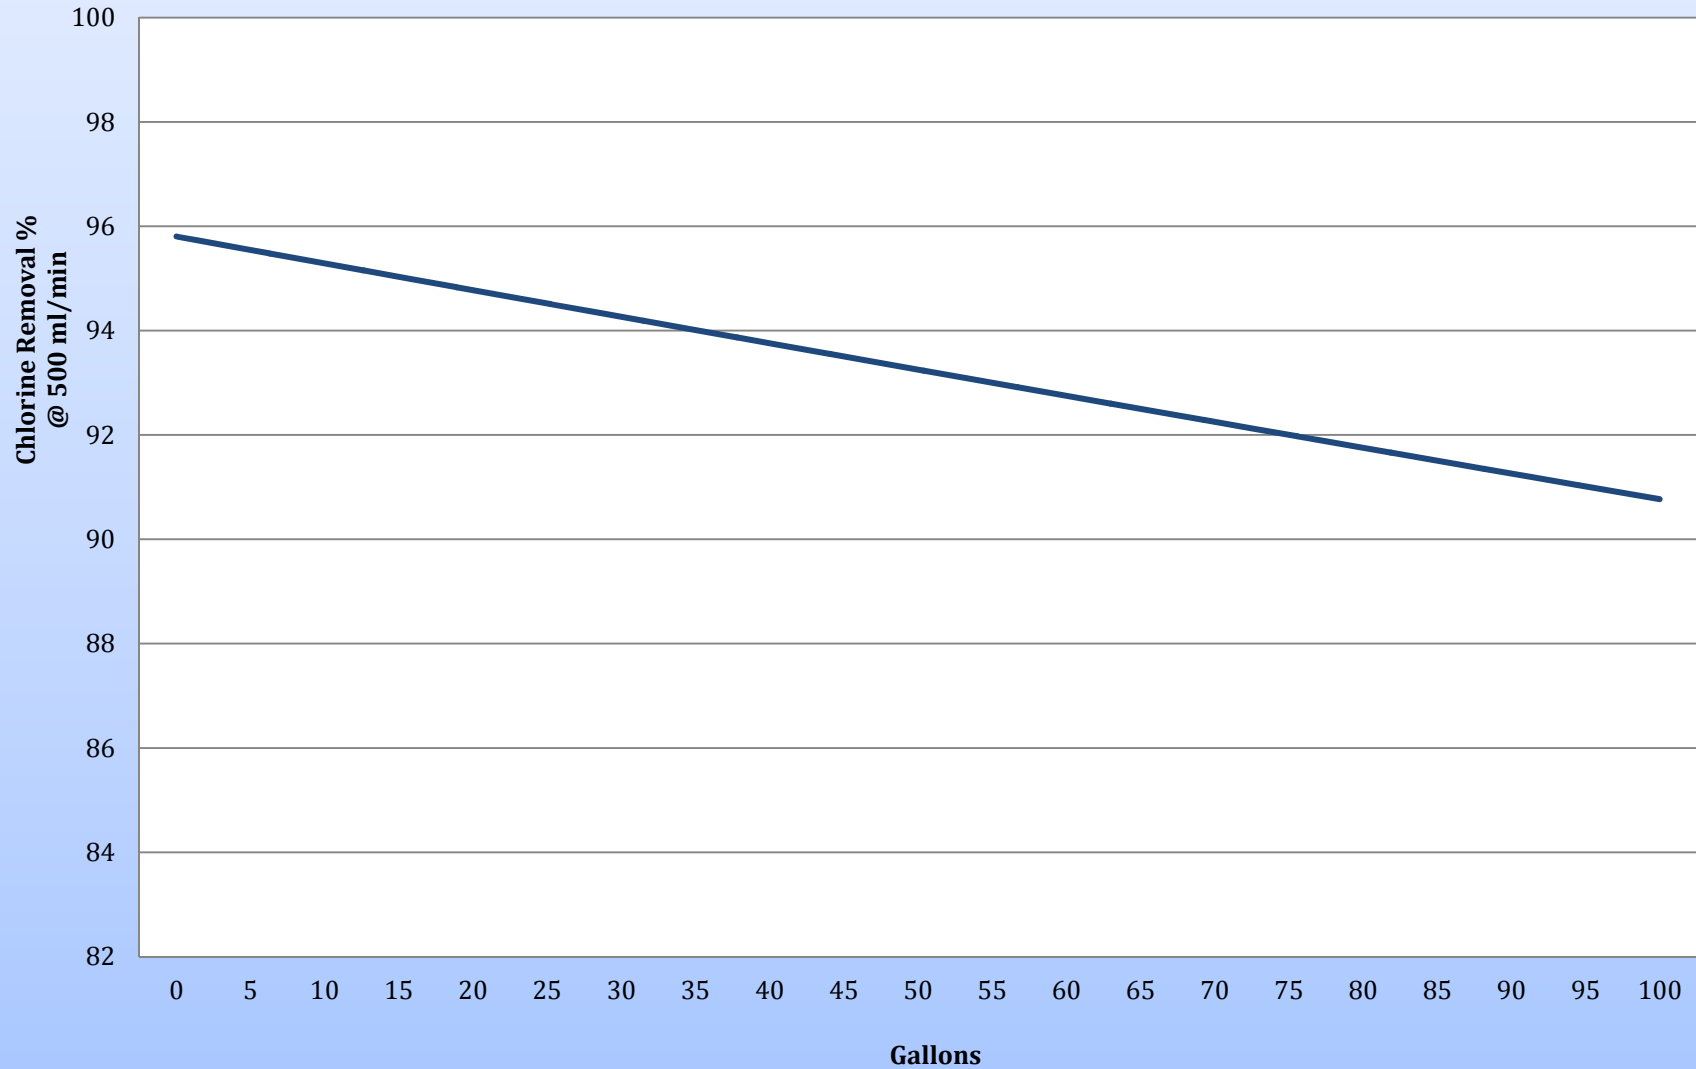

NSF Standard 42 Requirement: >50% removal of Chlorine @ 200 ml/min.